


SELECTION

SUPPLY


SOUND POWER, PRESSURE DROP

DIFFUSER LENGTH L [m]=1

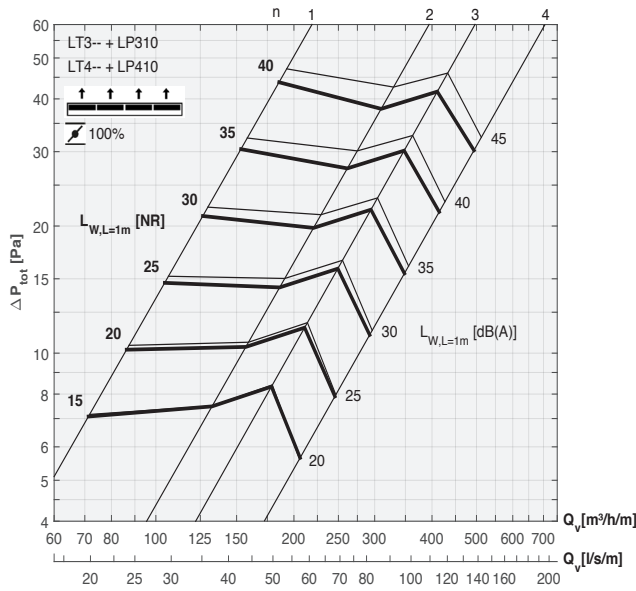


THROW

DIFFUSER LENGTH L [m]=1

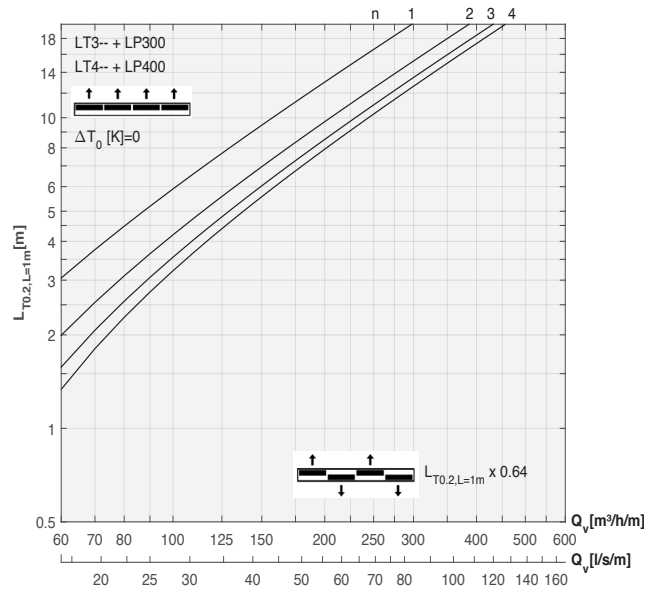

DISCHARGE VELOCITY

DIFFUSER LENGTH L [m]=1




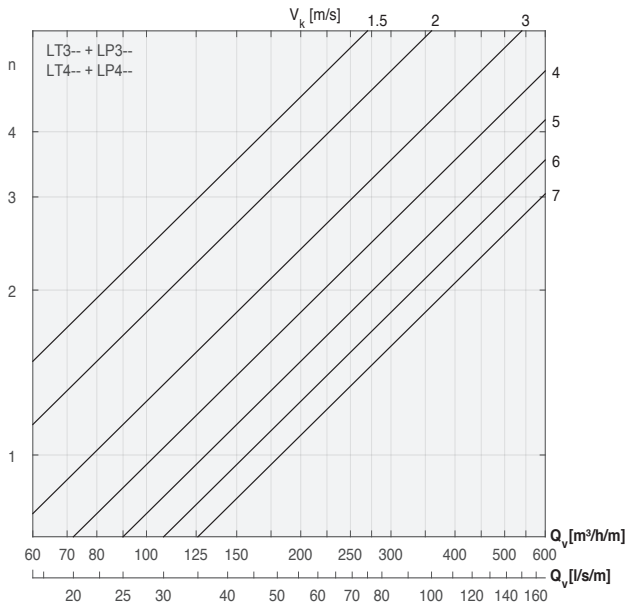


To calculate the airflow behavior in rooms as well as performance data such as sound level and pressure loss, please consult our [FACT selection software](#).

SELECTION

CRITICAL DISTANCE


DIFFUSER LENGTH L [m]=1

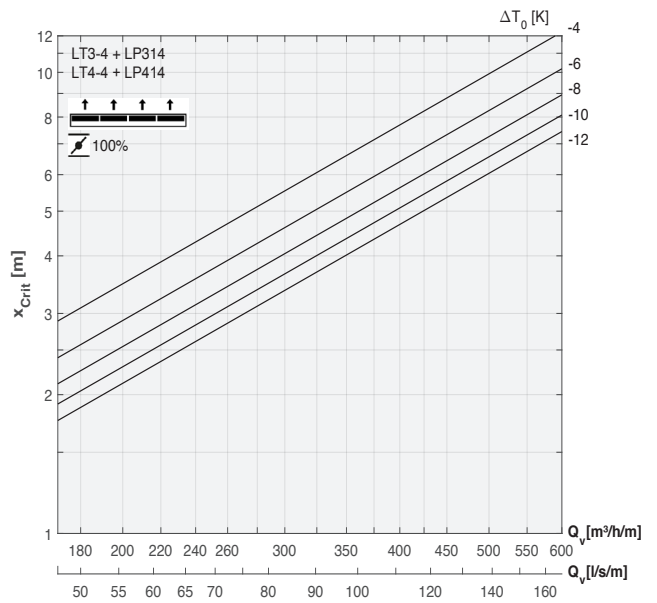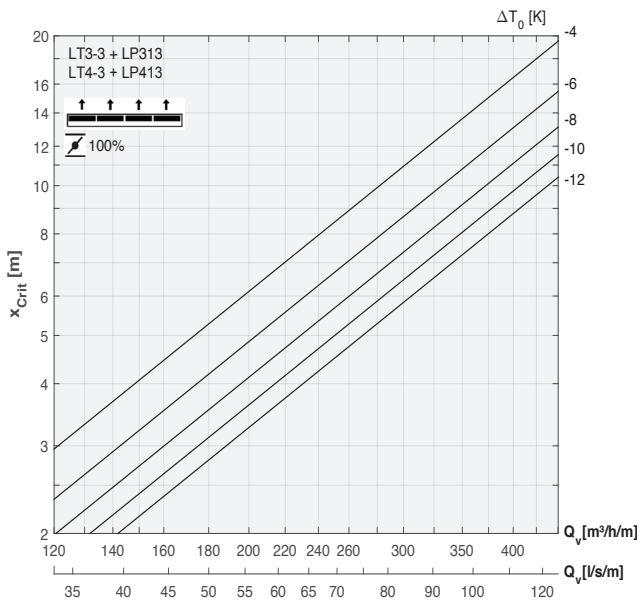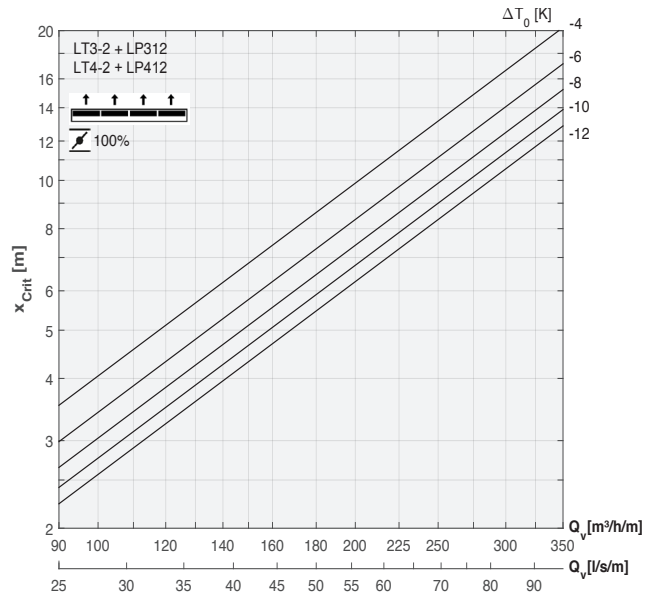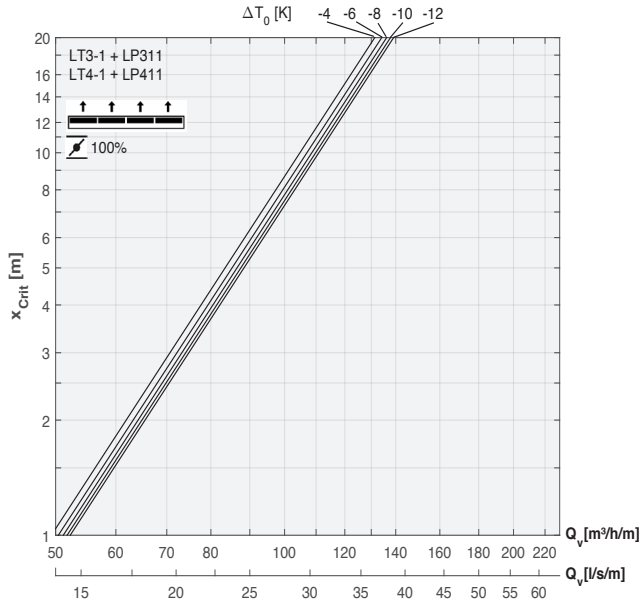


To calculate the airflow behavior in rooms as well as performance data such as sound level and pressure loss, please consult our [FACT selection software](#).

SELECTION
CORRECTION FACTORS SUPPLY

SOUND CORRECTION FOR ARBITRARY DIFFUSER LENGTH L

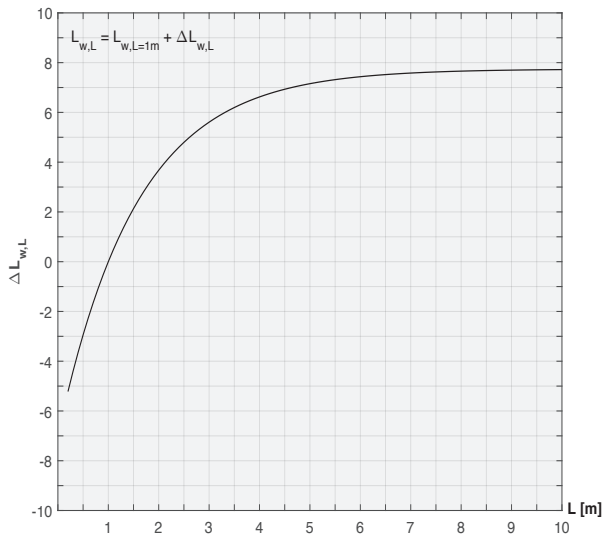

THROW CORRECTION FOR ARBITRARY DIFFUSER LENGTH L

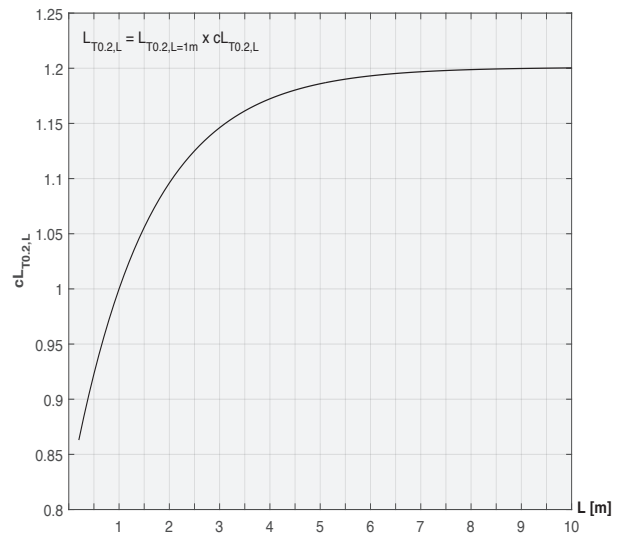
EFFECTIVE AIR DISCHARGE AREA

DIFFUSER LENGTH L [m]=1

n	1	2	3	4
A_k [m ² /m]	0,007	0,015	0,023	0,032

EXAMPLE SELECTION


Known data		
supply air flow rate, Q_v	[m ³ /h]	400
supply air temperature, T_0	[°C]	18
room temperature, T_a	[°C]	26
max. diffuser length, L	[mm]	2000
max. allowable sound pressure, L_p	[dB(A)]	35
room sound attenuation, ΔL_r	[dB(A)]	8
max. allowable velocity in occupied zone	[m/s]	0,2

Selection from graphs

flow rate for diffuser of L = 1000 mm	[m ³ /h/m]	200
Sound		
requested max. sound power, $L_{w,L}$ (= $L_p + \Delta L_r$)	[dB(A)]	43
sound power correction for diffuser length L, $\Delta L_{w,L}$	[dB(A)]	3,7
requested max. sound power for L= 1000 mm, $L_{w,L=1m}$	[dB(A)]	39,3
proposal of slot number, n	[-]	2
Pressure drop		
total pressure loss, ΔP_{tot}	[Pa]	13
Velocity		
throw correction factor, $cL_{T0,2,L}$	[-]	1,096
throw for diffuser of L = 1000 mm, $L_{T0,2,L=1m}$	[m]	9,7
throw for diffuser of L = 2000 mm, $L_{T0,2,L}$ (= $L_{T0,2,L=1m} \times cL_{T0,2,L}$)	[m]	10,8
air discharge surface area A_k (= $A_{k,L=1m} \times L/1000$)	[m ²]	0,0307
discharge velocity V_k , Q_v/A_k (or by graph)	[m/s]	3,6
critical distance @ $\Delta T_0 = T_a - T_0$, x_{crit}	[m]	8,1

 To calculate the airflow behavior in rooms as well as performance data such as sound level and pressure loss, please consult our **FACT selection software**.

SELECTION
LEGEND

Symbol	Unit	
A_k	[m ²]	effective air discharge surface area (measured)
$c_{L_{T0,2,L}}$	[m]	correction factor for the distance at which the jet centreline velocity decreases to 0.2 m/s for a diffuser with length L
L	[m]	length of diffuser
$L_{w,L}$	[NR] / [dB(A)]	sound power for a diffuser with length L
$\Delta L_{w,L}$	[NR] / [dB(A)]	sound power correction for a diffuser with length L relative to the length of 1 m
$L_{T0,2,L}$	[m]	distance at which the jet centreline velocity decreases to 0.2 m/s for a diffuser with length L
n	[-]	number of slots
ΔP_{tot}	[Pa]	total pressure loss
Q_v	[m ³ /h] / [l/s]	airflow
ΔT_0	[K]	temperature difference between ambient air and supply air
V_k	[m/s]	air discharge velocity based on A_k
x	[m]	distance measured from the diffuser's centre
	[%]	valve position (100% = open)

To calculate the airflow behavior in rooms as well as performance data such as sound level and pressure loss, please consult our **FACT selection software**.