



SELECTION

SUPPLY


SOUND POWER, PRESSURE DROP
GRILLE LENGTH L [m]=1

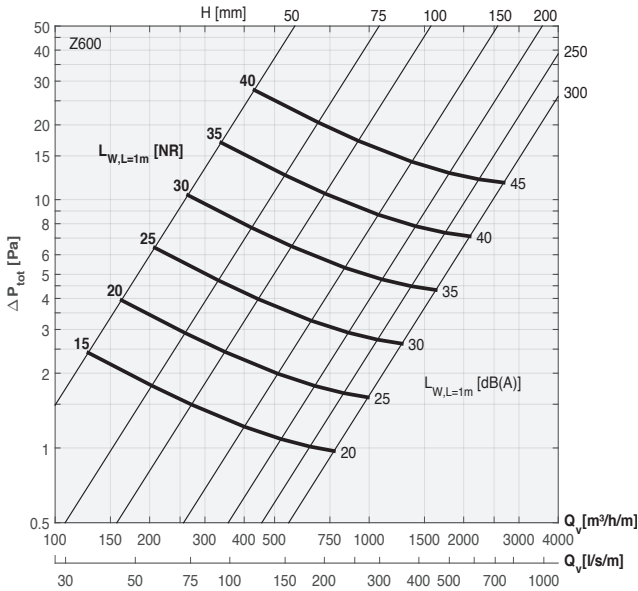


THROW
GRILLE LENGTH L [m]=1

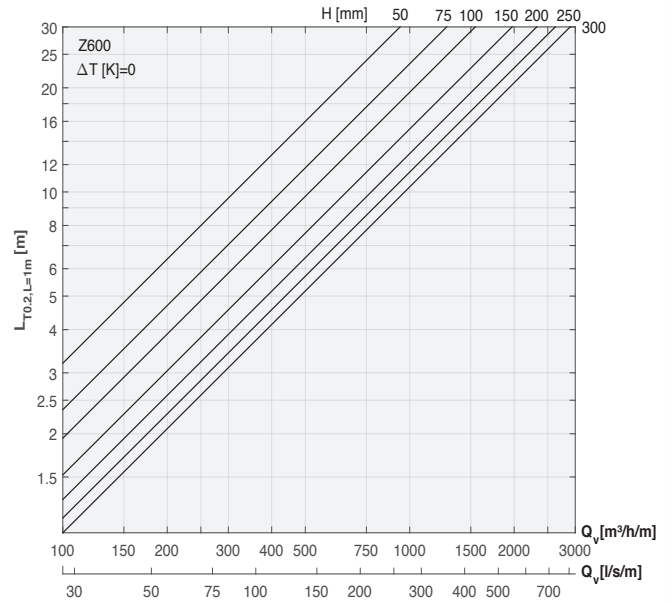

TEMPERATURE
GRILLE LENGTH L [m]=1

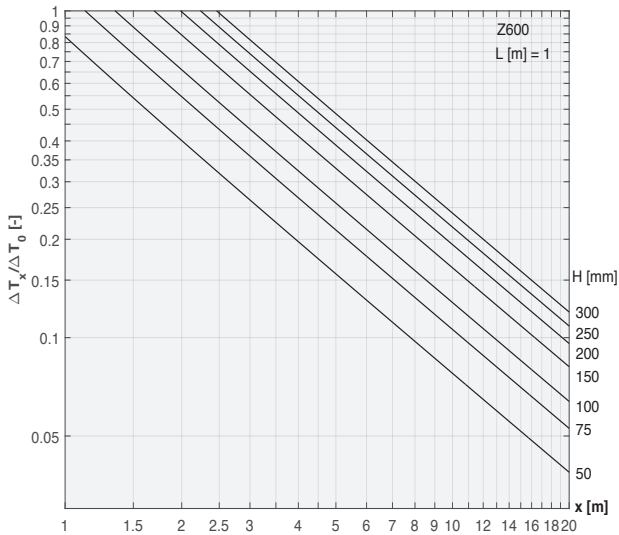

AIR DISCHARGE VELOCITY,
BASED ON AF

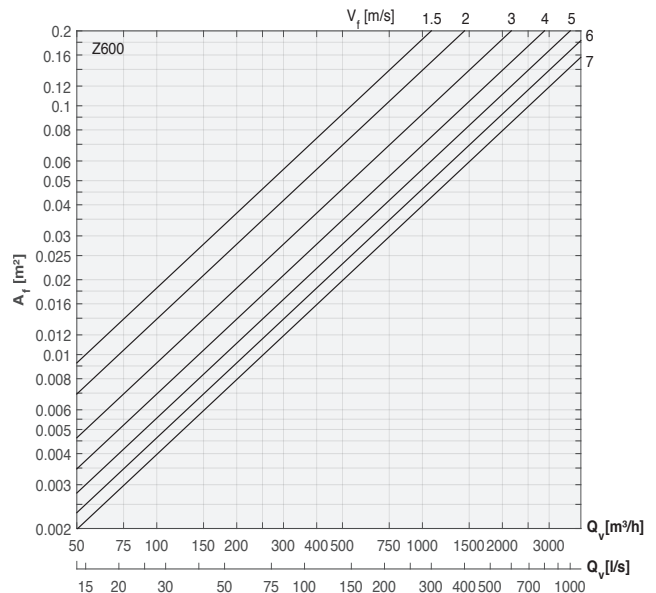



To calculate the airflow behavior in rooms as well as performance data such as sound level and pressure loss, please consult our [FACT selection software](#).

SELECTION

EXHAUST

SOUND POWER, PRESSURE DROP

GRILLE LENGTH L [m]=1

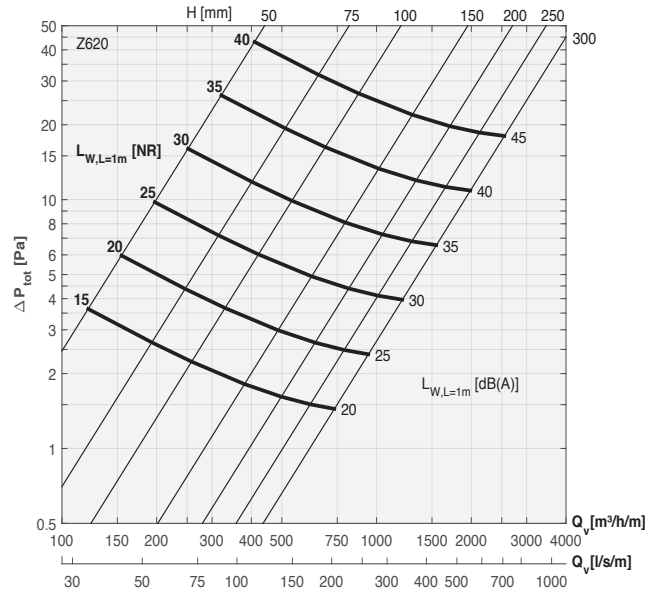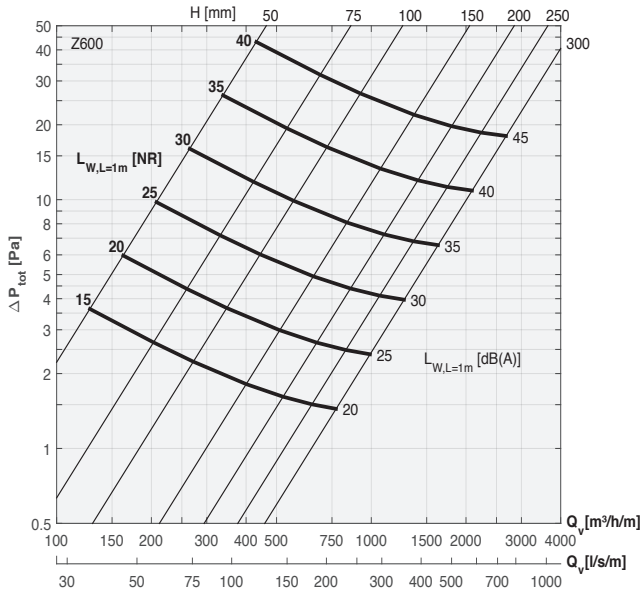


To calculate the airflow behavior in rooms as well as performance data such as sound level and pressure loss, please consult our [FACT selection software](#).


SELECTION

CORRECTION FACTORS

SOUND CORRECTION FOR ARBITRARY GRILLE LENGTH L

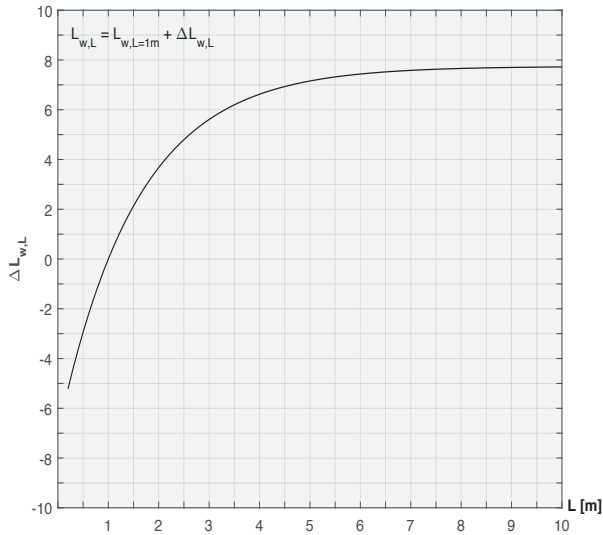

THROW CORRECTION FOR ARBITRARY GRILLE LENGTH L

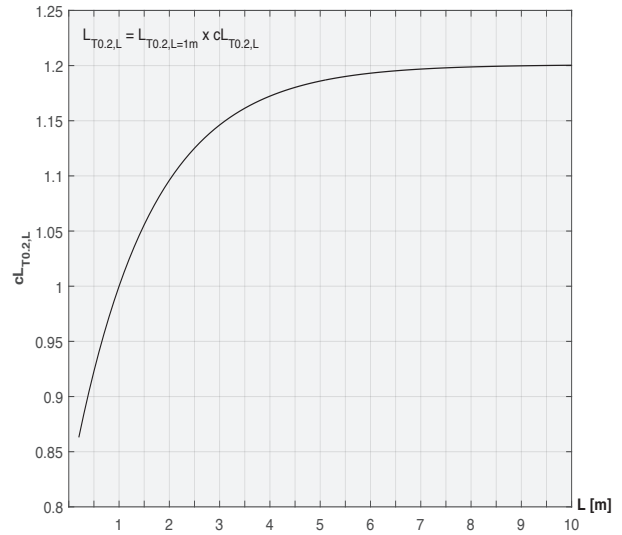

GEOMETRICAL AIR DISCHARGE SURFACE
AREA A_f. SUPPLY/EXHAUST

A _f [m ²]	L [mm]									
H [mm]	200	300	400	500	600	700	800	1000	1200	
37,5	0,002	0,003	0,004	0,005	0,006	0,006	0,007	0,009	0,011	
50	0,003	0,005	0,006	0,008	0,010	0,011	0,013	0,016	0,019	
75	0,006	0,009	0,012	0,015	0,018	0,021	0,024	0,030	0,036	
100	0,009	0,013	0,017	0,022	0,026	0,031	0,035	0,044	0,052	
150	0,014	0,021	0,029	0,036	0,043	0,050	0,057	0,071	0,086	
200	0,020	0,030	0,040	0,049	0,059	0,069	0,079	0,099	0,119	
250	0,025	0,038	0,051	0,063	0,076	0,088	0,101	0,126	0,152	

To calculate the airflow behavior in rooms as well as performance data such as sound level and pressure loss, please consult our [FACT selection software](#).

SELECTION
SELECTION EXAMPLE

Known data		
supply air flow rate, Q_v	[m ³ /h]	2000
supply air temperature, T_0	[°C]	18
room temperature, T_r	[°C]	26
diffuser length, L	[mm]	2000
max. allowable sound pressure, L_p	[dB(A)]	35
room sound attenuation, ΔL_r	[dB(A)]	8
max. allowable velocity in occupied zone	[m/s]	0,2

Selection from graphs		
flow rate for diffuser of L = 1000 mm	[m ³ /h/m]	1000
Sound		
requested max. sound power, $L_{w,L}$ (= $L_p + \Delta L_r$)	[dB(A)]	43
sound power correction for diffuser length L, $\Delta L_{w,L}$	[dB(A)]	3,7
requested max. sound power for L = 1000 mm, $L_{w,L=1m}$	[dB(A)]	39,3
proposal of grille height, H	[mm]	150
Pressure drop		
total pressure, ΔP_{tot}	[Pa]	8
Velocity		
throw correction factor, $c_{L_{T0,2,L}}$	[-]	1,096
throw for diffuser of L = 1000 mm, $L_{T0,2,L=1m}$	[m]	15,2
throw for diffuser of L = 2000 mm, $L_{T0,2,L}$ (= $L_{T0,2,L=1m} \times c_{L_{T0,2,L}}$)	[m]	16,7
air discharge surface area A_f (= $A_{f,L=1m} \times L/1000$)	[m ²]	0,1425
discharge velocity V_f , Q_v/A_f (or by graph)	[m/s]	3,9
Temperature		
temperature coefficient @ $L_{T0,2,L=1m}$, $\Delta T_x/\Delta T_0$	[-]	0,108
temperature coefficient @ $L_{T0,2,L}$, $\Delta T_x/\Delta T_0 \times c_{L_{T0,2,L}}$	[-]	0,118
-->temperature $T_x = T_a - (\Delta T_x/\Delta T_0 \times c_{L_{T0,2,L}})(T^a - T_0)$	[°C]	25,1

LEGEND

Symbol	Unit	
ΔP_{tot}	[Pa]	total pressure loss
Q_v	[m ³ /h/m] / [l/s/m]	airflow for a grille length of 1 m
ΔT_x	[K]	difference between ambient temperature and jet centreline temperature at distance x
ΔT_0	[K]	temperature difference between ambient air and supply air
L_w	[NR] / [dB(A)]	sound power
$L_{T0,2}$	[m]	distance at which the jet centreline velocity decreases to 0.2 m/s
x	[m]	distance measured from the diffuser's/ grille's centre
L	[m]	length of diffuser or grille
$L_{w,L}$	[NR] / [dB(A)]	sound power for a diffuser or grille with length L
$\Delta L_{w,L}$	[NR] / [dB(A)]	sound power correction for a diffuser or grille with length L relative to the length of 1 m
$L_{T0,2,L}$	[m]	distance at which the jet centreline velocity decreases to 0.2 m/s for a diffuser or grille with length L
$c_{L_{T0,2,L}}$	[m]	correction factor for the distance at which the jet centreline velocity decreases to 0.2 m/s for a diffuser or grille with length L